

## IO-Link KRT3B\_55 PLC Integration

IO-Link service data function block + process data parser  
function for Beckhoff (TwinCAT V2.x) PLC controls in  
combination with a PROFIBUS IO-Link Master

# Table of content

<b>1. About this document</b>	<b>3</b>
1.1. Function of this document	3
1.2. Target group	3
1.3. Scope	3
<b>2. Service data function block</b>	<b>4</b>
2.1. Block specifications	4
2.2. Method of function	5
2.3. Behavior when error occurs	5
2.4. Parameter	5
2.5. Error description	15
2.5.1. Error code (ERROR_CODE)	15
2.5.2. IO-Link error code (IOL_ERROR_CODE)	17
2.6. Including into the PLC project	18
<b>3. Process data parser function</b>	<b>19</b>
3.1. Block specifications	19
3.2. Parameter	19
3.3. Including into the PLC project	19

# 1. About this document

Please read this chapter carefully before working with this documentation and the Leuze IO-Link device.

## 1.1. Function of this document

These instructions have been designed for the technical personnel for the use of the IO-Link PLC blocks.

These instructions do not provide instructions for operating the machine, the system or the vehicle on which IO-Link devices are, or will be, integrated. Information on this is to be found in the appropriate operating instructions of the machine, the system or the vehicle.

## 1.2. Target group

These instructions are addressed to programming engineers and the operators of machines and systems which are operated by one or several IO-Link devices. They also address people, who connect the IO-Link device via an IO-Link-Master-Gateway to a PLC-Control for data exchange.

## 1.3. Scope

These function blocks are device type-specific and only suitable for the following Leuze IO-Link devices.

**Device family: contrast scanner**

**Device ID: 2130**



-KRTM 3B/L6.1121-S8 (50135163)



-KRTM 55/L6.1121,200-S12  
(50135164)

**The function block "FB\_Leuze\_KRT3B\_55\_PB"** interprets the call-up of the acyclic service data.

**The function "F\_Leuze\_PDInParser\_KRT3B\_55"** interprets the process data telegram sent from the IO-Link device.

The functionality of these PLC blocks depends on the IO-Link parameter set described by the IODD. This means, that these blocks also may be used for other Leuze devices (e.g. new device variants) with identical IO-Link parameter sets.

## 2. Service data function block

The function block "FB\_Leuze\_KRT3B\_55\_PB" simplifies the usage of Leuze IO-Link devices on Beckhoff (TwinCAT V2.x) PLC controls. The FB supports IO-Link Masters which can be connected via PROFIBUS to the PLC system.

The function block is device type-specific and thus only suitable for the appropriate Leuze IO-Link devices. The FB interprets the call-up of the acyclic service data between the PLC and the IO-Link device.

The IO-Link function block can only be used in combination with the listed helper functions / libraries.


### 2.1. Block specifications

Block name:	FB_Leuze_KRT3B_55_PB
Version:	1.0.0.0
Used blocks:	SIOL_C_PB R_TRIG TON LEN ADSREADEX ADSWRITE FB_EcCoESdoRead FB_EcCoESdoWrite
Used libraries:	IO-Link Base V2_0_0_0.lib STANDARD.lib TCBase.lib TcSystem.lib TcEtherCAT.lib TCUtilities.lib
Used structures:	ST_Leuze_KRT3B_55
Call up:	Cyclic
Programming language:	Structured text (ST)
Based on the IODD:	Leuze_electronic-KRT3B_2130-20161208-IODD1.1.xml (V1.1)



#### Attention!

The function block uses the library "IO-Link base" in the version V2.0.0.0. Please ensure, that you have installed the added it to your PLC project. The IO-Link base library is backward compatible and can also be used with older IO-Link function blocks.

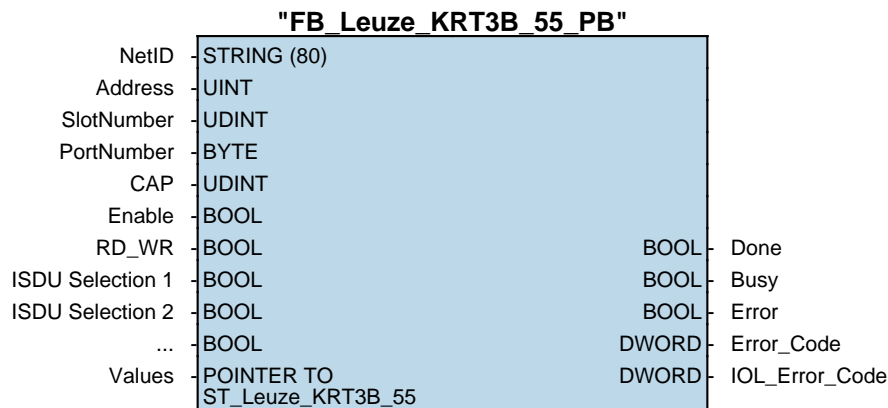

## 2.2. Method of function

The function block uses the data structure "ST\_Leuze\_KRT3B\_55". The data structure contains the values of all IO-Link variables. Before you can use it, the structure must be instantiated in the PLC program. Each IO-Link FB parameter has a data point representing it in this data structure. This data point will be actualized every time a read request was executed successfully.

A desired parameter can be selected via the input variables. Depending on the device definition, IO-Link parameters are read or writable. The input variable must be "RD\_WR" = FALSE to read parameter. The value that should be written can be defined in the data structure, as soon as the input parameter "RD\_WR" = TRUE. You start each transfer by calling up the function block "FB\_Leuze\_KRT3B\_55\_PB" with a positive trigger at the ENABLE input. As long as there is no valid answer the output BUSY is TRUE. In the case, the timeout period of 10 sec. has elapsed a timeout error will be generated and the thread will be terminated. The DONE = TRUE output shows that the transmission was successful. The outputs retain their states as long as there is no new positive trigger at the ENABLE input again.

## 2.3. Behavior when error occurs

An error bit (ERROR) is set and an error code (ERROR\_CODE/IOL\_ERROR\_CODE) generated, if there is a spurious input value or an incorrect input connection of the FB. In this case, no further processing is carried out, until the input has been corrected.

## 2.4. Parameter

Parameter name	Declaration	Data type	Description
NetID	INPUT	STRING (80)	AoeNetId of the PROFIBUS Master
Address	INPUT	UINT	PROFIBUS address of the IO-Link Master.
SlotNumber	INPUT	UDINT	Number of the slot where the IO-Link Master module put on.  Using a non modular decentralized peripherals the SlotNumber = 0.
PortNumber	INPUT	BYTE	Number of the port where the IO-Link device is connected to the IO-Link Master  1..255: Port number

Parameter name	Declaration	Data type	Description
CAP	INPUT	UDINT	Client access point of the IO-Link Master (IO-Link Master specific)  Siemens ET200: 227 Other manufacturers: 255
Enable	INPUT	BOOL	Positive trigger: Start data transfer
RD_WR	INPUT	BOOL	Read or write the selected IO-Link parameter.  FALSE: Read parameter TRUE: Write Parameter
SysCommand	INPUT	BOOL	Selection of the IO-Link parameter "Standard Command"  =====IO-Link parameter information: ===== IO-Link Index: 2 Access: Write only  Parameter values of the data structure (decimal): 128: Device Reset 130: Restore Factory Settings 192: sensitivity increase by one step 193: sensitivity decrease by one step 195: static 2-point teach start with background 197: dynamic 2-point teach start with background 198: test function 207: finalize 2-point teach 224: save current working parameter 225: restore last saved working parameter 226: save current working parameter to memory index 227: load saved working parameter from memory index
DeviceAccessLocks	INPUT	BOOL	Selection of the IO-Link parameter "Device Access Locks"  =====IO-Link parameter information: ===== IO-Link Index: 12 Access: Read/Write
VendorName	INPUT	BOOL	Selection of the IO-Link parameter "Vendor Name"  =====IO-Link parameter information: ===== IO-Link Index: 16 Access: Read only
VendorText	INPUT	BOOL	Selection of the IO-Link parameter "Vendor Text"  =====IO-Link parameter information: ===== IO-Link Index: 17 Access: Read only
ProductName	INPUT	BOOL	Selection of the IO-Link parameter "Product Name"  =====IO-Link parameter information: ===== IO-Link Index: 18 Access: Read only
ProductID	INPUT	BOOL	Selection of the IO-Link parameter "Product ID"  =====IO-Link parameter information: ===== IO-Link Index: 19 Access: Read only

Parameter name	Declaration	Data type	Description
ProductText	INPUT	BOOL	Selection of the IO-Link parameter "Product Text"  =====IO-Link parameter information: ===== IO-Link Index: 20 Access: Read only
SerialNumber	INPUT	BOOL	Selection of the IO-Link parameter "Serial Number"  =====IO-Link parameter information: ===== IO-Link Index: 21 Access: Read only
HWVersion	INPUT	BOOL	Selection of the IO-Link parameter "Hardware Version"  =====IO-Link parameter information: ===== IO-Link Index: 22 Access: Read only
FWVersion	INPUT	BOOL	Selection of the IO-Link parameter "Firmware Version"  =====IO-Link parameter information: ===== IO-Link Index: 23 Access: Read only
AppliName	INPUT	BOOL	Selection of the IO-Link parameter "Application Specific Tag"  =====IO-Link parameter information: ===== IO-Link Index: 24 Access: Read/Write
EasyTuneLockState	INPUT	BOOL	Selection of the IO-Link parameter "EasyTune lock state"  =====IO-Link parameter information: ===== IO-Link Index: 70 Access: Read/Write
TeachButtonLockState	INPUT	BOOL	Selection of the IO-Link parameter "teach button lock state"  =====IO-Link parameter information: ===== IO-Link Index: 71 Access: Read/Write
SwitchingOutput1Func	INPUT	BOOL	Selection of the IO-Link parameter "switching output 1 function"  =====IO-Link parameter information: ===== IO-Link Index: 72 Access: Read/Write  Parameter values of the data structure (decimal): 0: true on mark 1: true on background
SwitchingOutput2Func	INPUT	BOOL	Selection of the IO-Link parameter "switching output 2 function"  =====IO-Link parameter information: ===== IO-Link Index: 73 Access: Read/Write  Parameter values of the data structure (decimal): 0: inverted switching output 1 1: equal switching output 1

Parameter name	Declaration	Data type	Description
TimerUnit	INPUT	BOOL	Selection of the IO-Link parameter "timer unit"  =====IO-Link parameter information: ===== IO-Link Index: 74 Access: Read/Write
FunctionOfTimerUnit	INPUT	BOOL	Selection of the IO-Link parameter "function of timer unit"  =====IO-Link parameter information: ===== IO-Link Index: 75 Access: Read/Write  Parameter values of the data structure (decimal): 1: on delay 2: off delay 3: pulse stretching 4: pulse suppression
_Time	INPUT	BOOL	Selection of the IO-Link parameter "time"  =====IO-Link parameter information: ===== IO-Link Index: 76 Access: Read/Write  Parameter values of the data structure (decimal): 1-50000
ColorsAtTeach	INPUT	BOOL	Selection of the IO-Link parameter "colors at teach"  =====IO-Link parameter information: ===== IO-Link Index: 77 Access: Read/Write  Parameter values of the data structure (decimal): 1: red 2: green 4: blue 3: red, green 5: red, blue 6: green, blue 7: all
PosSwThres1PTIOL	INPUT	BOOL	Selection of the IO-Link parameter "position of switching threshold, 1-point teach, IO-Link"  =====IO-Link parameter information: ===== IO-Link Index: 78 Access: Read/Write



Parameter name	Declaration	Data type	Description
PosSwThres2PTIOL	INPUT	BOOL	<p>Selection of the IO-Link parameter "position of switching threshold, 2-point teach, IO-Link"</p> <p>=====IO-Link parameter information: ===== IO-Link Index: 79 Access: Read/Write</p> <p>Parameter values of the data structure (decimal): 6: very close to the mark = 6% 12: close to the mark = 12% 25: toward mark = 25% 50: in the middle between the mark and background = 50% 70: in direction of the background = 70% 82: close to the background = 82% 90: very close to the background = 90% 7-11: very close to the background = 90% 13-24: very close to the background = 90% 26-49: very close to the background = 90% 51-69: very close to the background = 90% 71-81: very close to the background = 90% 83-89: very close to the background = 90% 91-94: very close to the background = 90%</p>
PosSwThres1PTBS1	INPUT	BOOL	<p>Selection of the IO-Link parameter "position of switching threshold, 1-point teach, button, sensitivity 1"</p> <p>=====IO-Link parameter information: ===== IO-Link Index: 80 Access: Read/Write</p>
PosSwThres1PTBS2	INPUT	BOOL	<p>Selection of the IO-Link parameter "position of switching threshold, 1-point teach, button, sensitivity 2"</p> <p>=====IO-Link parameter information: ===== IO-Link Index: 81 Access: Read/Write</p>
PosSwThres2PTBS1	INPUT	BOOL	<p>Selection of the IO-Link parameter "position of switching threshold, 2-point teach, button, sensitivity 1"</p> <p>=====IO-Link parameter information: ===== IO-Link Index: 82 Access: Read/Write</p> <p>Parameter values of the data structure (decimal): 6: very close to the mark = 6% 12: close to the mark = 12% 25: toward mark = 25% 50: in the middle between the mark and background = 50% 70: in direction of the background = 70% 82: close to the background = 82% 90: very close to the background = 90% 7-11: very close to the background = 90% 13-24: very close to the background = 90% 26-49: very close to the background = 90% 51-69: very close to the background = 90% 71-81: very close to the background = 90% 83-89: very close to the background = 90% 91-94: very close to the background = 90%</p>

Parameter name	Declaration	Data type	Description
PosSwThres2PTBS2	INPUT	BOOL	<p>Selection of the IO-Link parameter "position of switching threshold, 2-point teach, button, sensitivity 2"</p> <p>=====IO-Link parameter information: ===== IO-Link Index: 83 Access: Read/Write</p> <p>Parameter values of the data structure (decimal): 6: very close to the mark = 6% 12: close to the mark = 12% 25: toward mark = 25% 50: in the middle between the mark and background = 50% 70: in direction of the background = 70% 82: close to the background = 82% 90: very close to the background = 90% 7-11: very close to the background = 90% 13-24: very close to the background = 90% 26-49: very close to the background = 90% 51-69: very close to the background = 90% 71-81: very close to the background = 90% 83-89: very close to the background = 90% 91-94: very close to the background = 90%</p>
AnalysisDepth	INPUT	BOOL	<p>Selection of the IO-Link parameter "analysis depth"</p> <p>=====IO-Link parameter information: ===== IO-Link Index: 84 Access: Read/Write</p> <p>Parameter values of the data structure (decimal): 1-10</p>
WorkingParameter0	INPUT	BOOL	<p>Selection of the IO-Link parameter "working parameter 0"</p> <p>=====IO-Link parameter information: ===== IO-Link Index: 100 Access: Read/Write</p>
WorkingParameter1	INPUT	BOOL	<p>Selection of the IO-Link parameter "working parameter 1"</p> <p>=====IO-Link parameter information: ===== IO-Link Index: 101 Access: Read/Write</p>
WorkingParameter2	INPUT	BOOL	<p>Selection of the IO-Link parameter "working parameter 2"</p> <p>=====IO-Link parameter information: ===== IO-Link Index: 102 Access: Read/Write</p>
WorkingParameter3	INPUT	BOOL	<p>Selection of the IO-Link parameter "working parameter 3"</p> <p>=====IO-Link parameter information: ===== IO-Link Index: 103 Access: Read/Write</p>

Parameter name	Declaration	Data type	Description
WorkingParameter4	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 4"  =====IO-Link parameter information: ===== IO-Link Index: 104 Access: Read/Write
WorkingParameter5	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 5"  =====IO-Link parameter information: ===== IO-Link Index: 105 Access: Read/Write
WorkingParameter6	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 6"  =====IO-Link parameter information: ===== IO-Link Index: 106 Access: Read/Write
WorkingParameter7	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 7"  =====IO-Link parameter information: ===== IO-Link Index: 107 Access: Read/Write
WorkingParameter8	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 8"  =====IO-Link parameter information: ===== IO-Link Index: 108 Access: Read/Write
WorkingParameter9	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 9"  =====IO-Link parameter information: ===== IO-Link Index: 109 Access: Read/Write
WorkingParameter10	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 10"  =====IO-Link parameter information: ===== IO-Link Index: 110 Access: Read/Write
WorkingParameter11	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 11"  =====IO-Link parameter information: ===== IO-Link Index: 111 Access: Read/Write
WorkingParameter12	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 12"  =====IO-Link parameter information: ===== IO-Link Index: 112 Access: Read/Write
WorkingParameter13	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 13"  =====IO-Link parameter information: ===== IO-Link Index: 113 Access: Read/Write

Parameter name	Declaration	Data type	Description
WorkingParameter14	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 14"  =====IO-Link parameter information: ===== IO-Link Index: 114 Access: Read/Write
WorkingParameter15	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 15"  =====IO-Link parameter information: ===== IO-Link Index: 115 Access: Read/Write
WorkingParameter16	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 16"  =====IO-Link parameter information: ===== IO-Link Index: 116 Access: Read/Write
WorkingParameter17	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 17"  =====IO-Link parameter information: ===== IO-Link Index: 117 Access: Read/Write
WorkingParameter18	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 18"  =====IO-Link parameter information: ===== IO-Link Index: 118 Access: Read/Write
WorkingParameter19	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 19"  =====IO-Link parameter information: ===== IO-Link Index: 119 Access: Read/Write
WorkingParameter20	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 20"  =====IO-Link parameter information: ===== IO-Link Index: 120 Access: Read/Write
WorkingParameter21	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 21"  =====IO-Link parameter information: ===== IO-Link Index: 121 Access: Read/Write
WorkingParameter22	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 22"  =====IO-Link parameter information: ===== IO-Link Index: 122 Access: Read/Write
WorkingParameter23	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 23"  =====IO-Link parameter information: ===== IO-Link Index: 123 Access: Read/Write

Parameter name	Declaration	Data type	Description
WorkingParameter24	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 24"  =====IO-Link parameter information: ===== IO-Link Index: 124 Access: Read/Write
WorkingParameter25	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 25"  =====IO-Link parameter information: ===== IO-Link Index: 125 Access: Read/Write
WorkingParameter26	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 26"  =====IO-Link parameter information: ===== IO-Link Index: 126 Access: Read/Write
WorkingParameter27	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 27"  =====IO-Link parameter information: ===== IO-Link Index: 127 Access: Read/Write
WorkingParameter28	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 28"  =====IO-Link parameter information: ===== IO-Link Index: 128 Access: Read/Write
WorkingParameter29	INPUT	BOOL	Selection of the IO-Link parameter "working parameter 29"  =====IO-Link parameter information: ===== IO-Link Index: 129 Access: Read/Write
WorkingParameter	INPUT	BOOL	Selection of the IO-Link parameter "working parameter"  =====IO-Link parameter information: ===== IO-Link Index: 130 Access: Read/Write
TeachButtonFunction	INPUT	BOOL	Selection of the IO-Link parameter "teach button function"  =====IO-Link parameter information: ===== IO-Link Index: 150 Access: Read only
ActiveTransmitter	INPUT	BOOL	Selection of the IO-Link parameter "active transmitter"  =====IO-Link parameter information: ===== IO-Link Index: 170 Access: Read/Write  Parameter values of the data structure (decimal): 0: red 1: green 2: blue

Parameter name	Declaration	Data type	Description
Amplification	INPUT	BOOL	Selection of the IO-Link parameter "amplification"  =====IO-Link parameter information: ===== IO-Link Index: 171 Access: Read/Write
BackgroundValue	INPUT	BOOL	Selection of the IO-Link parameter "background value"  =====IO-Link parameter information: ===== IO-Link Index: 172 Access: Read/Write
MarkValue	INPUT	BOOL	Selection of the IO-Link parameter "mark value"  =====IO-Link parameter information: ===== IO-Link Index: 173 Access: Read/Write
HighSwitchingThresho	INPUT	BOOL	Selection of the IO-Link parameter "high switching threshold"  =====IO-Link parameter information: ===== IO-Link Index: 174 Access: Read/Write
LowSwitchingThreshol	INPUT	BOOL	Selection of the IO-Link parameter "low switching threshold"  =====IO-Link parameter information: ===== IO-Link Index: 175 Access: Read/Write
BackgroundOffsetValu	INPUT	BOOL	Selection of the IO-Link parameter "background offset value"  =====IO-Link parameter information: ===== IO-Link Index: 176 Access: Read/Write
NumberOfMarks	INPUT	BOOL	Selection of the IO-Link parameter "number of marks"  =====IO-Link parameter information: ===== IO-Link Index: 177 Access: Read/Write
WorkingParamMemIdx	INPUT	BOOL	Selection of the IO-Link parameter "working parameter memory index"  =====IO-Link parameter information: ===== IO-Link Index: 178 Access: Read/Write  Parameter values of the data structure (decimal): 0-29
MeasuredValue	INPUT	BOOL	Selection of the IO-Link parameter "measured value"  =====IO-Link parameter information: ===== IO-Link Index: 200 Access: Read only

Parameter name	Declaration	Data type	Description
Values	INPUT	POINTER TO ST_Leuze_KRT3B_55	Pointer to the instance of the data structure ST_Leuze_KRT3B_55.  Example: VAR stIOLData: ST_Leuze_KRT3B_55; END_VAR  Values:= ADR(stIOLData);
Done	OUTPUT	BOOL	Indicates whether data is valid.
Busy	OUTPUT	BOOL	Request in process.  FALSE: Request is terminated TRUE: Request is being processed
Error	OUTPUT	BOOL	Error flag  FALSE: No error TRUE: Error detected
Error_Code	OUTPUT	DWORD	Error code
IOL_Error_Code	OUTPUT	DWORD	IO-Link error code

## 2.5. Error description

### 2.5.1. Error code (ERROR\_CODE)

The parameter ERROR\_CODE contains detailed information of the occurred error:

WORD 1	WORD 0
Block error	ADS communication error

Device errors are errors send from the connected device. Communication errors are errors generated by the used standard function blocks "ADSWRITE" and "ADSREADEX". Further information is given in the documentation of these function blocks.

Error code (WORD 0)	Error code
0x0001 ... 0x001B	Global error codes (see Beckhoff ADS return codes)
0x0500 ... 0x050A	Router error codes (see Beckhoff ADS return codes)
0x0700 ... 0x0755	Generals ADS error codes (see Beckhoff ADS return codes)
0x1000 ... 0x1010	RTime error codes (see Beckhoff ADS return codes)
0x274C ... 0x2751	Socket error codes (see Beckhoff ADS return codes)

For further information see ADS Return Codes (Beckhoff).

Error code (WORD 1)	Error code
0x0000	No error
0x0001	Only one parameter can be selected at the same time
0x0002	The function block was initiated without any choice of parameter
0x0003	Chosen parameter cannot be read
0x0004	Chosen parameter cannot be written
0x0005	The value to transmit is bigger then allowed for this data type
0x0006	The value to transmit is less then allowed for this data type
0x0007	Reserved
0x0008	Reserved

Error code (WORD 1)	Error code
0x0009	Time out error occurred
0x0100	(FB_IOL_Call_PB): IO-Link Index > 32767
0x0200	(FB_IOL_Call_PB): Invalid parameter (Length > 232)
0x0400	(FB_IOL_Call_PB): Timeout
0x0600	(FB_IOL_Call_PB): Inconsistent data received



## 2.5.2. IO-Link error code (IOL\_ERROR\_CODE)

The parameter IOL\_ERROR\_CODE contains detailed information of the occurred error:

WORD 1	WORD 0
IO-Link error code (IO-Link device)	IO-Link error code (IO-Link master)

IO-Link Device errors are errors send from the connected device. WORD 0 (IO-Link Master error) of the IOL\_Error\_Code describe errors from the connected PROFIBUS IO-Link Master.

Further information is given in the PROFIBUS IO-Link specification ([www.profibus.com](http://www.profibus.com)).

Error code (WORD 0)	Error code
0x0000	No error
0x0001 ... 0x06FF	Reserved / Master specific
0x7000	Unexpected Write request instead of read request / Invalid response PDU
0x7001	Decode error
0x7002	Port occupied by another task
0x7003 ... 0x7FFF	Reserved / Master specific
0x8001	IO-link index > 32767
0x8002	Port address beyond defined maximum
0x8003	Port function not supported
0x8004 ... 0xFFFF	Reserved / Master specific

Error code (WORD 1)	Error code
0x0000	No error
0x1000	Master communication error
0x1100	ISDU time out / Device event error
0x5200	Device checksum error
0x5600	Device buffer overflow
0x5700	Master ISDU illegal service
0x8000	The requested service has been refused by the device application
0x8011	Read write access to a not existing Index
0x8012	Read write access to a not existing sub index
0x8020	Parameter is not accessible for a read or write service due to the current state in the device
0x8021	Parameter is not accessible for a read or write service due to an ongoing local operation at the device
0x8022	Parameter is not accessible for a read or write service due to an remote triggered state of the device application
0x8023	Write service tries to access a read-only parameter
0x8030	Write service to a parameter outside its permitted range of values
0x8031	Write service to a parameter above its specified value range
0x8032	Write service to a parameter below its specified value range
0x8033	Write service to a parameter above its specified length
0x8034	Write service to a parameter below its predefined length
0x8035	Write service with a command value not supported by the device application
0x8036	Write service with a command value calling a device function not available due to the current state

Error code (WORD 1)	Error code
0x8040	The value via single parameter transfer collide with other actual parameter settings
0x8041	Inconsistent parameter set
0x8082	The read or write service is refused due to a temporarily unavailable application
0x8100	Unspecified
0x8101 ... 0x81FF	Device specific (see device description)


For additional information see the product description or the IO-Link specification ([www.IO-Link.com](http://www.IO-Link.com)).

## 2.6. Including into the PLC project

The function block "FB\_Leuze\_KRT3B\_55\_PB" is a part of the TwinCAT V2.x "" library. The library can be included by using the library manager of TwinCAT PLC Control.

The function block uses the "IO-Link Base" communication library. Please make sure that the library has been added to your project. The "IO-Link Base" library is available on [www.leuze-electronic.de](http://www.leuze-electronic.de).

If several devices connect to the IO-Link Master, you can only communicate with one device over the acyclic communication. Due this restriction, the communication blocks must to be blocked against each other.

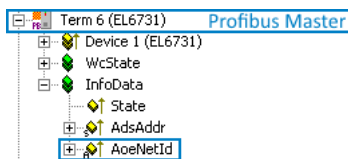

### Attention!

If several devices connect to the IO-Link Master, you can only communicate with one device over the acyclic communication. Due this restriction, the communication blocks must to be blocked against each other.


## 3. Process data parser function

The function F\_Leuze\_PDInParser\_KRT3B\_55 simplifies the interpretation of composed IO-Link process data. This data is provided as a data structure on the PLC side.

The function is device type-specific and thus only suitable for the appropriated Leuze IO-Link devices.

### 3.1. Block specifications

Block name:	F_Leuze_PDInParser_KRT3B_55
Version:	1.0
Used structures:	ST_Leuze_PDInParser_KRT3B_55
Programming language:	Structured text (ST)
Based on the IODD:	Leuze_electronic-KRT3B_2130-20161208-IODD1.1.xml (V1.1)

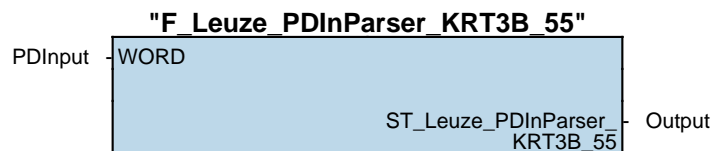

### 3.2. Parameter

Parameter name	Declaration	Data type	Description
PDInput	INPUT	WORD	Raw process data of the IO-Link device. Please make sure that the byte order is not swapped.
Output	OUTPUT	ST_Leuze_PDInParser_KRT3B_55	Reference to the instance of the data structure ST_Leuze_PDInParser_KRT3B_55. The structure includes the disaggregated values of the process data.

### 3.3. Including into the PLC project

The function "F\_Leuze\_PDInParser\_KRT3B\_55" is a part of the IO-Link library. The library can be included by using the TwinCAT library manager. The function needs the process data of the IO-Link device as an input value. The process data is obtained by linking a PLC variable via AT-declaration with the process value of the IO-Link device in the TwinCAT System Manager. Please make sure that the byte order is not swapped (see picture). The output value of the function is a data structure which includes the disaggregated values of the process data.

