



MSI-sx/Rx

Modular Safety Interface



Notes on connection and operating instructions

These connecting and operating instructions contain information on the proper use of MSI Safety Interfaces in accordance with its intended purpose.



All the information contained herein, in particular the safety notes, need to be carefully observed.

Notes regarding safety and warnings are marked by this symbol .

These connecting and operating instructions must be stored carefully. It must be available for the entire operating time of the MSI Safety Interfaces.

The Leuze electronic GmbH + Co. KG is not liable for damages caused by improper use. Acquaintance with these instructions is an element of the knowledge required for proper use.

© Reprints and reproduction, in whole or in part, are permitted only with the explicit permission of

Leuze electronic GmbH + Co. KG
In der Braike 1
D-73277 Owen - Teck / Germany
Phone +49 (0) 7021 / 573-0
Fax +49 (0) 7021 / 573-199
info@leuze.de
www.leuze.com

Table of contents

1	System Overview and Range of Applications	4	3.3.1.3	Operating Mode: With Start/Restart Interlock – Without External Device Monitoring	17
1.1	General Information	4	3.3.1.4	Operating Mode: Without Start/Restart Interlock – Without External Device Monitoring	17
1.2	Approvals	4	3.3.1.5	Operating Mode: With Start/Without Restart Interlock – Without External Device Monitoring	18
1.3	Terminology	5	3.3.2	Relay Operation: Monitoring Function Pre-failure Message in /Rx Versions	18
1.4	Nomenclature MSI-sx/Rx	6	3.4	Displays	19
2	Safety	7	3.5	Status Outputs	20
2.1	Approved purpose and foreseeable improper operation	7	3.6	Diagnosis Function	21
2.1.1	Proper use	8	4	Electrical Connection	23
2.1.2	Foreseeable misuse	10	4.1	Installation Regulations	23
2.2	Competent personnel	10	4.2	Power Supply Requirements	23
2.3	Responsibility for safety	10	4.3	Connecting AOPDs, Type 4 or Type 2	23
2.4	Exemption of liability	11	4.4	Connecting Machine Controls	27
2.5	Emergency STOP buttons to be connected	11	6	Technical Data and Ordering Information	30
3.1	System Configuration	12	6.1	MSI-sx/Rx	30
3.2	DIP Switch Settings	13	6.2	/Rx-Output	32
3.2.1	DIP Switch Settings for the MSI-sx Module	13	6.3	Dimensional Drawing	33
3.2.2	DIP Switch Settings for the Rx Output	13	6.4	Ordering Information	34
3.3	Operating Modes and Functions	15	7	EC Declaration of Conformity	35
3.3.1	Operating Modes: Interlocking Functions and External Device Monitoring	15			
3.3.1.1	Operating Mode: With Start/Restart Interlock – With Dynamic External Device Monitoring	16			
3.3.1.2	Operating Mode: With Start/Restart Interlock – With Static External Device Monitoring	16			

1 System Overview and Range of Applications

1.1 General Information

The Modular Safety Interface (MSI) serves as a link between one or more active optoelectronic protective devices (AOPD), Type 2, Type 3 or Type 4, and the machine controls. All MSI safety components include start/restart interlock and external device monitoring functions that can be activated and deactivated. They are also equipped with a series of status outputs and LED displays as well as a diagnosis interface to a PC.

Leuze electronic offers a range of additional MSI safety interfaces with standard and special function, e.g. muting or cyclical operation (single break, double break).

All MSI safety modules are equipped with relay outputs. The MSI x-variants allow the additional connection of safety interlocks or emergency-stop buttons regarding category 4.

1.2 Approvals

Europe
EC Type Examination DIN EN ISO 13849-1/2 GS-ET-20 "Safety relays" IFA Institut für Arbeitsschutz der Deutschen Gesetzlichen Unfallversicherung D-53757 Sankt Augustin

1.3 Terminology

AOPD	Active Optoelectronic Protective Device
Diagn.	Diagnosis Function
EDM	External Device Monitoring
ESPE	Electro-sensitive Protecting Equipment
Fault	Relay Fault
Locked	Start/Restart Interlock active
N.C.	Normal Closed Contact
N.O.	Normal Open Contact
OSSD	Safety-related switching output
Reset	Start/Restart Interlock Initiator
RS 232	Interface RS 232

S1 - S4	Safety input 1 - 4
S1 & S2 S3 & S4	Indication Protected fields free/interrupted
SSD	Secondary Switching Device (switches to ON state when the MSI is ready for operation)
Test	Test Signal Outputs
T1, T2	Test signal output 1, 2
Warn. (Rx Module)	Warning (preset number of switching actuations exceeded)

1.4 Nomenclature MSI-sx/Rx

MSI	Modular Safety Interface
s	standard
x	extended functions The extended version offers the following standard functions for either 2 AOPDs, Type 4, or up to 4 AOPDs, Type 2: – Start/restart interlock – External device monitoring – Diagnosis function
/Rx	Relay output with extended functions: – two normal open safety contacts, OSSD 1 and OSSD 2 – one normal closed safety contact OSSD 3 – one normal open contact "MSI readiness" SSD Additional special function: – relay operation monitoring with pre-failure message

2 Safety

Before using the Safety Interface Device, a risk evaluation must be performed according to valid standards (e.g. ISO 14121, EN ISO 12100-1, ISO 13849-1, EN 62061). The result of the risk assessment determines the required safety level of the Safety Interface Device (see table in chapter 2.1.1). For mounting, operating and testing, document "MSI-sx/Rx Modular Safety Interface Device" as well as all applicable national and international standards, regulations, rules and directives must be observed. Relevant and supplied documents must be observed, printed out and handed to the affected personnel.

Before working with the Safety Interface Device, completely read and understand the documents applicable to your task.

In particular, the following national and international legal regulations apply for the start-up, technical inspections and work with safety sensors:

- Machinery directive 2006/42/EC

2.1 Approved purpose and foreseeable improper operation



Warning!

A running machine can cause severe injuries!

- Low Voltage Directive 2006/95/EC
- Electromagnetic compatibility directive 2004/108/EC
- Use of Work Equipment Directive 89/655/EEC supplemented by Directive 95/63 EC
- OSHA 1910 Subpart O
- Safety regulations
- Accident-prevention regulations and safety rules
- Ordinance on Industrial Safety and Health and Labor Protection Act
- Device Safety Act



For safety-related information you may also contact the local authorities (e.g., industrial inspectorate, employer's liability insurance association, labor inspectorate, occupational safety and health authority).

Make certain that, during all conversions, maintenance work and inspections, the system is securely shut down and protected against being restarted again.

2.1.1 Proper use

The Safety Interface Device must only be used after it has been selected in accordance with the respectively applicable instructions and relevant standards, rules and regulations regarding labor protection and occupational safety, and after it has been installed on the machine, connected, commissioned, and checked by a competent person.

- When selecting the Safety Interface Device it must be ensured that its safety-related capability meets or exceeds the required performance level PLr ascertained in the risk assessment.

The following table shows the safety-related characteristic parameters of the MSI-sx/Rx modular Safety Interface Devices.

Type in accordance with DIN EN IEC 61496-1	Type 4												
SIL in accordance with IEC 61508	SIL 3												
Performance Level (PL) in accordance with DIN EN ISO 13849-1	PL e												
Category in accordance with DIN EN ISO 13849-1	Cat. 4												
Mean probability of a dangerous failure per hour (PFH _d) as a function of the mean number of annual switching cycles of the relay n _{op} *	<table> <tr> <td>100% Last n_{op} = 4.800:</td> <td>1,6 x 10⁻⁰⁸ 1/h</td> </tr> <tr> <td>60% Last n_{op} = 4.800:</td> <td>1,3 x 10⁻⁰⁸ 1/h</td> </tr> <tr> <td>100% Last n_{op} = 28.800:</td> <td>3,8 x 10⁻⁰⁸ 1/h</td> </tr> <tr> <td>60% Last n_{op} = 28.800:</td> <td>1,6 x 10⁻⁰⁸ 1/h</td> </tr> <tr> <td>100% Last n_{op} = 86.400:</td> <td>9,5 x 10⁻⁰⁸ 1/h</td> </tr> <tr> <td>60% Last n_{op} = 86.400:</td> <td>2,4 x 10⁻⁰⁸ 1/h</td> </tr> </table>	100% Last n _{op} = 4.800:	1,6 x 10 ⁻⁰⁸ 1/h	60% Last n _{op} = 4.800:	1,3 x 10 ⁻⁰⁸ 1/h	100% Last n _{op} = 28.800:	3,8 x 10 ⁻⁰⁸ 1/h	60% Last n _{op} = 28.800:	1,6 x 10 ⁻⁰⁸ 1/h	100% Last n _{op} = 86.400:	9,5 x 10 ⁻⁰⁸ 1/h	60% Last n _{op} = 86.400:	2,4 x 10 ⁻⁰⁸ 1/h
100% Last n _{op} = 4.800:	1,6 x 10 ⁻⁰⁸ 1/h												
60% Last n _{op} = 4.800:	1,3 x 10 ⁻⁰⁸ 1/h												
100% Last n _{op} = 28.800:	3,8 x 10 ⁻⁰⁸ 1/h												
60% Last n _{op} = 28.800:	1,6 x 10 ⁻⁰⁸ 1/h												
100% Last n _{op} = 86.400:	9,5 x 10 ⁻⁰⁸ 1/h												
60% Last n _{op} = 86.400:	2,4 x 10 ⁻⁰⁸ 1/h												
*n _{op} = mean number of annual actuations, see C.4.2 and C.4.3 of DIN EN ISO 13849-1:2008													
Use the following formula to calculate the mean number of annual actuations:													
$n_{op} = (d_{op} \cdot h_{op} \cdot 3600 \text{ s/h}) \div t_{Zyklus}$													
In doing so, make the following assumptions with regard to the use of the component:													
h _{op} = mean operating time in hours per day													
d _{op} = mean operating time in days per year													
t _{Zyklus} = mean time between the start of two successive cycles of the component (e.g switching of a valve) in seconds per cycle													

- The Safety Interface Device is used in combination with one or more Multiple Light Beam Safety Devices or Safety Light Curtains to safeguard danger or hazard areas.
- The control of the machine or system that is to be safeguarded must be electrically influenceable. A switch-off command initiated by an MSI must result in an immediate shutdown of the dangerous movement.
- The "Reset" acknowledgment button for unlocking the start/restart interlock must be mounted in such a way that the entire danger zone can be seen from its mounting location.
- Message outputs (state outputs) and SSDs (Secondary Switching Device), must not be used for switching safety-relevant signals.
- The Safety Interface Device is designed for installation in a cabinet or a protective housing with a protection rating of at least IP 54.
- The 24 V DC $\pm 20\%$ power supply must guarantee safe isolation from the mains voltage and be able to bridge a power outage period of 20 ms.
- Depending on external wiring, dangerous voltages may be present at the switching outputs. In addition to the power supply, these must be switched off and safeguarded against being switched back on prior to all work on the MSI-sx.
- These operating instructions must be included with the documentation of the machine on which the protective device is installed so that they are available to the operator at all times.
- In the event of changes to the MSI-sx, all warranty claims against the manufacturer of the Safety Interface Device are rendered void.
- The safety distance between the AOPD and the point of operation is to be maintained. It is calculated according to the formulas for machine-specific C standards or given in the general B1 standard ISO 13855. Both the reaction time of the Test Monitoring Unit and the braking time of the machine must be taken into account.
- Two switching contacts must always be looped into the switch-off circuit of the machine. To prevent welding, relay switching contacts must be fused/protected externally according to the technical data.
- The Safety Interface Device must be exchanged after a maximum of 20 years. Repairs or the exchange of parts subject to wear and tear do not extend the service life.
- The Safety Interface Device satisfies the requirements of safety category 4 acc. to ISO 13849-1. If, however, an AOPD of a lower safety category is connected, the total category for the given path of the control cannot be higher than that of the connected AOPD.
- Cross connections between S1 and S2 or S3 and S4 are only detected by the MSI safety device if both time-staggered test signal outputs, T1 and T2, are used for the connected protective device(s) with relay output. AODPs of type 4 with safety-relevant transistor outputs and their own cross circuit monitoring can be directly connected to S1 and S2 or S3 and S4.

2.1.2 Foreseeable misuse

Any use other than that defined under the "intended use" or which goes beyond that use is considered improper use!

e.g.
applications in explosive or easily flammable atmospheres

2.2 Competent personnel

Prerequisites for competent personnel:

- has a suitable technical education
- he knows the rules and regulations for occupational safety, safety at work and safety technology and can assess the safety of the machine

2.3 Responsibility for safety

Manufacturer and operating company must ensure that the machine and implemented Safety Interface Device function properly and that all affected persons are adequately informed and trained.

The type and content of all imparted information must not lead to unsafe actions by users.



Attention!

Such instances can jeopardize the health and lives of the personnel operating the machinery and/or may cause damage to property.

- he knows the instructions for the Safety Interface Device and the machine
- has been instructed by the responsible person on the mounting and operation of the machine and of the Safety Interface Device

The manufacturer of the machine is responsible for:

- safe machine construction
- safe implementation of the Safety Interface Device
- imparting all relevant information to the operating company
- adhering to all regulations and directives for the safe starting-up of the machine

The operator of the machine is responsible for:

- instructing the operating personnel
- maintaining the safe operation of the machine

2.4 Exemption of liability

Leuze electronic GmbH + Co. KG is not liable in the following cases:

- Safety Interface Device is not used as intended
- safety notices are not adhered to
- reasonably foreseeable misuse is not taken into account

2.5 Emergency STOP buttons to be connected

- It must be secured that the EMERGENCY STOP function is always and immediate effective. EMERGENCY STOP buttons must not be connected at sensor inputs which provide for muting or cycling control functions! In Chapter 5, Connection examples, there is a particular example illustrating the connection of an EMERGENCY STOP button.

- adhering to all regulations and directives for occupational safety and safety at work
- regular testing by competent personnel (see chapter 2.2 and 2)
- mounting and electrical connection are not properly performed
- proper function is not tested
- changes (e.g., constructional) are made to the Safety Interface Device
- When a two-channel Section Emergency Stop button is connected, MSI is able to realize a Section Emergency Stop function. Section Emergency Stop buttons connected to the MSI only affect the safety circuit that is assigned to the AOPD. For this reason, it is referred to as an Section Emergency Stop. The limited area of effect of the button must be identified for the operating staff in a manner that is clearly visible.

3 System Configuration and Functions

3.1 System Configuration

Two microprocessors handle the redundant processing of the signal sequences within the intelligent Modular Safety Interface MSI. The results of the two processors are continuously compared. If any deviations are found, the safety-related outputs are immediately switched off and the LED indicating an MSI failure lights up.

Sensor signals at inputs S1 and S2 as well as S3 and S4 are checked. Depending on which of the functions (as described below) are selected, when the protected fields of all connected AOPDs are free the MSI outputs switch automatically to the ON state (without start/restart interlock) or remain in the OFF state until the reset button has been pressed and released (with start/restart interlock = standard operating mode).

MSI-sx is available with two output options: the MSI-sx/Rx has two positive-guided normal open contacts and one positive-guided normal closed contact and offers furthermore an additional normal open contact SSD (Secondary Switching Device) which assumes the ON state when the MSI is ready for operation.



The SSD contact does not open when a protected field is interrupted! It may be used to switch off a second path if the MSI Safety Interface falls into an error condition.

The MSI safety interface comes in a 35 mm-wide slide-in housing that holds the MSI-sx module and the output module. It is suitable for mounting on a grounded 35 mm standard rail.

3.2 DIP Switch Settings

3.2.1 DIP Switch Settings for the MSI-sx Module

Cut off the voltage supply to the interface (see safety precautions) loosen the subassembly with the imprint

"MSI-sx" and pull this module partly out of the housing before resetting the DIP switches:



Functions **only** in conjunction with external wiring, see Chapter 3.3:

DIP Switch	DS4	DS3	DS2	DS1
Function	None	Locking	External Device Monitoring	None
Up		restart interlock only	Static •- none ••	–
Down		start/restart interlock* - none **	dynamic	–

Factory setting: all switches down

* See Chapter 3.3.1.1 – 3.3.1.3

** See Chapter 3.3.1.4

- See Chapter 3.3.1.2
- See Chapter 3.3.1.3 – 3.3.1.5

3.2.2 DIP Switch Settings for the Rx Output

Cut off the voltage supply to the interface (see safety precautions) loosen the subassembly Rx Output and pull

it partly out of the housing before resetting the DIP switches:



DIP Switches	RX2	RX1
Function	Warning: 1,000,000 operations performed	
Up		
Down	x	x

DIP Switches	RX2	RX1
Function	Warning: 500,000 operations performed	
Up	x	
Down		x

DIP Switches	RX2	RX1
Function	Warning: 200,000 operations performed	
Up		x
Down	x	

DIP Switches	RX2	RX1
Function	Warning: 100,000 operations performed	
Up	x	x
Down		

Factory setting: switches down (Warning after 1,000,000 operations)

Recommended setting: See Chapter 3.3.2

3.3 Operating Modes and Functions

3.3.1 Operating Modes: Interlocking Functions and External Device Monitoring

The following 5 combinations can be selected by externally wiring the MSI Safety interface and/or by changing

the settings of the DIP switches DS2 and DS3 in the MSI Module:

OPERATING MODES		
Chapter	Type of Locking	Type of External Device Monitoring
3.3.1.1	With start/restart interlock	with dynamic ext. device monitoring
3.3.1.2	With start/restart interlock	with static ext. device monitoring
3.3.1.3	With start/restart interlock	without external device monitoring
3.3.1.4	Without start/restart interlock	without external device monitoring
3.3.1.5	With start/without restart interlock	without external device monitoring



The MSI safety interface is factory-set for the operating mode "with start/restart interlock and dynamic external device monitoring". If this setting is changed, these functions (i.e. the appropriate safety level) must be guaranteed by other means.

- Types of interlocking functions
The start interlock function ensures that when the system is switched on or when the supply voltage returns, even if the protected field is free the safety-related output contacts (OSSDs) do not automatically go into ON state, but rather wait until the reset button has been pressed and let go. The start/restart interlock function prevents the OSSDs from automatically entering the ON state when the protected fields of one or more of the connected AOPDs are released again

after an interruption. Here as well, the reset button must be pressed and let go to initiate the system.

- Types of External Device Monitoring
The function dynamic external device monitoring monitors the relays connected downstream from the MSI safety interface. Each time before the OSSDs switch to the ON state, a check is made of whether the subsequent circuit elements have closed and reopened. If they have not, the OSSDs of the MSI safety interface remain in the OFF state. If the function static external device monitoring is selected, a check is merely made of whether the subsequent circuit elements are in an open state. If they are, the start/restart interlock can be initiated.

3.3.1.1 Operating Mode: With Start/Restart Interlock – With Dynamic External Device Monitoring


External wiring requirements:

- Terminal 13 connected to 24 V DC by way of a start button "Reset"
- Terminal 14 connected to 0 V by way of feedback contacts of the positive-guided downstream relay

Required DIP switch settings in the MSI module (Chapter 3.2):

- DS3 down DS2 down (factory setting at delivery)

Start/restart interlock is no longer active when the protected fields of all connected AOPDs are free, the downstream relays have returned to their original state, and the reset button is pressed and released.

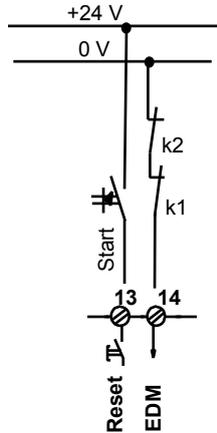

3.3.1.2 Operating Mode: With Start/Restart Interlock – With Static External Device Monitoring


External wiring requirements:

- Terminal 13 connected to 24 V DC "Reset" by way of a start button
- Terminal 14 connected to 0 V by way of feedback contacts of the positive-guided downstream relay

Required DIP switch settings in the MSI module (Chapter 3.2):

- DS3 down DS2 up

In this operating mode, if the protected fields are free, a check is merely made of whether the downstream circuit elements have returned to their original state. If so, a release is issued by pressing and letting go of the reset button.

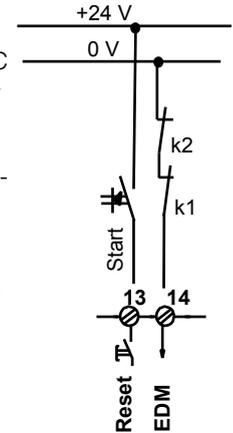

The dynamic monitoring of the downstream relays, which may be required in order to maintain the safety category, must be performed by other means.

3.3.1.3 Operating Mode: With Start/Restart Interlock – Without External Device Monitoring

External wiring requirements:

Terminal 13 connected to 24 V DC "Reset" by way of a start button


Terminal 14 connected to 0 V "EDM"

Required DIP switch settings in the MSI module (Chapter 3.2):

DS3 down DS2 up



The dynamic monitoring of the downstream relays, which may be required in order to maintain the safety category, must be performed by other means.

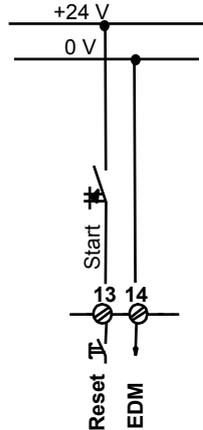

3.3.1.4 Operating Mode: Without Start/Restart Interlock – Without External Device Monitoring

External wiring requirements:

Terminal 13 connected to 0 V "Reset"


Terminal 14 connected to 24 V DC "EDM"

Required DIP switch settings in the MSI module (Chapter 3.2):

DS3 down DS2 up



After the supply voltage is applied, the OSSDs immediately go into the ON state if all of the protected fields of the connected AOPDs are free.

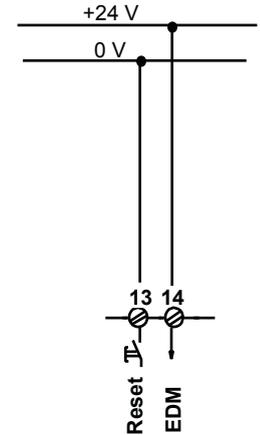

In this case, the start/restart interlock function and the dynamic monitoring of the downstream relays, which may be required in order to maintain the safety category, must be performed by other means.

3.3.1.5 Operating Mode: With Start/Without Restart Interlock – Without External Device Monitoring

External wiring requirements:


Terminal 13 connected to 0 V "Reset"

Terminal 14 connected to 24 V DC "EDM"

Required DIP switch settings in the MSI module (Chapter 3.2):

DS3 up DS2 up

After the supply voltage is applied, the OSSDs remain in the OFF state even if all of the protected fields of the connected AOPDs are free.

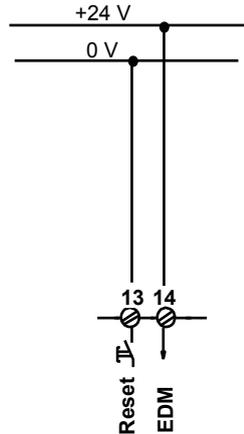

When the protected fields of all connected AOPDs are initially free, the OSSDs first enter the ON state when the protected field of the AOPD connected at S1 (for Type 4: S1 and S2) is interrupted and released. Only then do the rest of the connected AOPDs respond to the interruption and release of their own protected fields by switching the OSSDs directly to the OFF and ON states.

In this case, the start/restart interlock function and the dynamic monitoring of the downstream circuit elements, which may be required in order to maintain the safety category, must be performed by other means.

3.3.2 Relay Operation: Monitoring Function Pre-failure Message in /Rx Versions

For purposes of preventive maintenance, the /Rx output subassemblies are equipped with a function that counts the number of relay operations and issues a pre-failure message. Four different values can be selected at the DIP switches on the subassembly. Before the DIP switches can be set, the Rx subassembly must be completely disconnected from all power sources. It can then be

released from its two holding brackets with a screwdriver and pulled slightly out of the housing.

The table below shows the recommended DIP switch settings with respect to the switching current. Switching voltages of up to 60 V DC and 250 V AC are admissible.


OSSD Switching current (Switching Voltage 60 V DC, 250 V AC max.)	≤ 0.75 A	> 0.75 A ≤ 1.5 A	>1.5 A ≤ 3 A	> 3 A ≤ 5 A
Recommended number of Operations	1,000,000 (factory setting)	500,000	200,000	100,000

For setting, see Chapter 3.2.2.

3.4 Displays

A number of LEDs of various colors indicate the operating status of the MSI modular safety interface. It is also possible to show the LED displays on the PC monitor

using the integrated RS 232 interface and diagnosis connector.

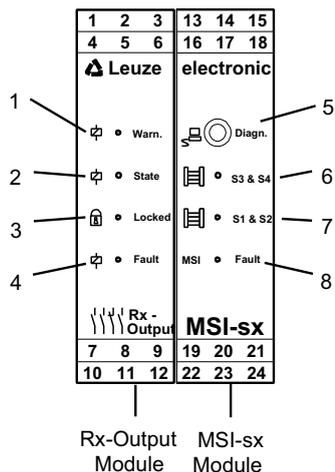


Output /Rx					
Position	Display/Function	Symbol	Status	LED	Color
1	Preset no. of relay operations (/Rx only)	relay/ Warn	reached not reached	on off	red
2	Safety-related switch output	relay	on off	on on	green red
3	Start/restart interlock	lock	locked not locked	on off	yellow
4	Fault in output module	relay	fault no fault	on off	red

MSI-sx Module					
Position	Display/Function	Symbol	Status	LED	Color
5	Diagnosis, RS 232 See status outputs	jack diagn.	none	none	none
6	Protected field	AOPDs S3 & S4	protected field free not free	on off	green
7	Protected field	AOPDs S1 & S2	protected field free not free	on off	green
8	MSI fault	MSI fault	fault no fault	on off	red

3.5 Status Outputs

Status outputs are not allowed to be used as safety-related signals in release circuits (see also

Chapter Safety, Operating Conditions and Proper Use).

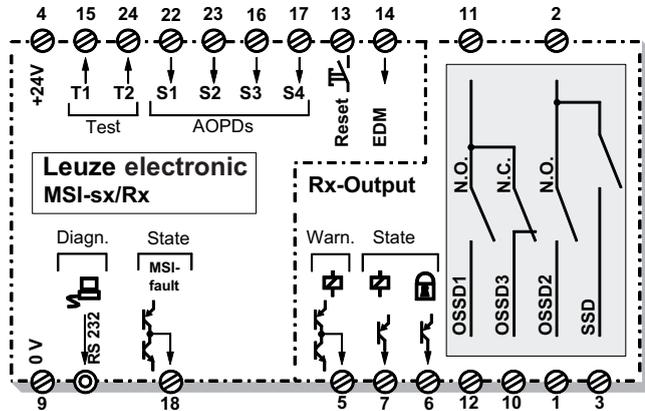

Output /Rx				
Terminal	Message Function	Symbol	Status	Status Output
5	preset no. of relay operations (/Rx only)	relay	not reached reached	active high active low
6	Start/restart interlock	lock	locked not locked	active high active low
7	Safety-related switch status	relay	ON OFF	active high active low

MSI-sx Module				
Terminal	Message Function	Symbol	Status	Status Output
Front jack	Diagnosis, RS 232 2.5 mm round connector	–	–	connected to PC with Diagnosis program
18	MSI fault	MSI-fault	no fault fault	active high active low

3.6 Diagnosis Function

Requirements for running the diagnosis system: a standard PC or laptop operating under Windows (Version 3.1 or higher) and the MSI software, Version 01, as well as a serial connection cable and a 2.5 mm jack plug.

- Simultaneous display of all input and output statuses as well as all LED displays on the MSI

With its diagnosis interface, the intelligent modular safety interface MSI offers a convenient way to visualize all of

the input and output statuses simultaneously on the monitor.

The connection circuit diagram as well as display fields in different colors can be shown on the screen via the connection terminals. A graphic representation of the MSI front design with the display elements as described in Chapter 3.4 also appears on the screen.

Example:

The screenshot shows the 'Diagnose-Programm MSI' software interface. It features a terminal grid on the left with 'Leuze electronic' and 'MSI-SX' labels. The main area contains a configuration table for 'Prog. version' and various test parameters. Below the table is a detailed wiring diagram showing terminals 4, 15, 24, 22, 23, 16, 17, 13, 14, 11, 2, 9, 18, 5, 7, 6, 12, 10, 1, 3. It includes components like 'Test', 'AOPDs', 'Rx-Output', and 'Warm. State'.

Prog. version:	0.00	restart-interlock:	without
S1:	n.c.	EDM - mode:	dynamic
S2:	n.c.	EDM:	without
S3:	n.c.	relay prewarming:	100k
S4:	n.c.	relay zyklen:	0k
ME1:	n.c.	SS1a:	n.c.
ME2:	n.c.	SS1b:	n.c.
ME3:	n.c.	SS2a:	n.c.
ME4:	n.c.	SS2b:	n.c.
		start test emulation:	no
		time monitoring:	without
		muting sensor test:	without
		muting timeout:	without
		muting mode:	Leuze

This enables the sequences at individual screw-type terminals to be tracked without the use of additional measuring instruments. The diagnosis function is equip-

ped with online help and can be operated in either English or German.

4 Electrical Connection

4.1 Installation Regulations



The general safety precautions must be observed. The electrical installation may be performed only if there is no voltage applied, and it must be performed by trained specialists.



In the /Rx versions, it is possible that high voltages may be present at the output contacts. A no-voltage state is achieved only when the 24 V DC supply voltage as well as the supply lines to the switch contacts are safely

4.2 Power Supply Requirements



The supply voltage of 24 V DC must guarantee safe mains separation and be able to bridge an interruption in voltage of 20 ms at full load. The functional earth connection of the MSI is established when snapped onto

4.3 Connecting AOPDs, Type 4 or Type 2

The examples below show possibilities for connecting and combining AOPDs of various safety categories and with various output features (relays, safety-oriented transistor outputs, cross circuit monitoring within and outside the AOPD).

AOPDs Type 4 with transistor outputs and cross connection monitoring function can directly connected to the safety inputs S1 and S2, respectively to S3 and S4. See Example 1.

switched off and secured against being switched on again.



Coded plug-in terminal blocks allow a connection cross-section of up to 2.5 mm². The supply voltage must be externally fused against excess current with a fuse of 2.5 AmT. The switch contacts must also be externally fused against excess current with a maximum of 4A gG. This prevents the safety-related contacts from welding together if the current load is too high!

the grounded metal mounting rail via the rear clamp fixture.

The lead for the supply voltage must be externally fused against excess current with a maximum of 2.5 AmT.

All available safety inputs must be occupied! In case no components are connected, the remaining inputs must be connected to the corresponding test signal using bridges. In doing so, please note that the odd-numbered test signal must be connected to the odd-numbered safety input via the non-delaying bridge (T1 => S1 or S3) and vice versa (T2 => S2 or S4). See Example 2.

AOPDs Type 4 with relay outputs, safety switches or emergency stop buttons must be connected so that the odd-numbered test signal T1 are directed via the non-delaying contacts to an odd-numbered safety input (T1=>S1 or S3) and vice versa (T2=>S2 or S4). See Example 3 and 4.

AOPDs Type 2 are periodically tested using the time-displaced test signals T1 or T2. The odd-numbered test signal must be directed to an even-numbered safety input by the way of the time-delaying AOPD (T1=>S2 or S4) and vice versa (T2=>S1 or S3). The AOPD response time to a test request must be in a range of 2 to 18 ms. See Example 5 and 6.




Using both, the safety inputs S1 & S2 and S3 & S4 separate insulated connector cables must be used to avoid undetected cross connections between S1 and S3 respectively S2 and S4. Cross connections between S1 and S2 as well as between S3 and S4 are automatically detected.

If type 2 AOPDs are connected:

- according to DIN EN IEC 61496-1, only a maximum of PL c or SIL CL 1 can be achieved!
- when cables are laid without protection, a failure detection time of up to 10 s is possible.


Example 1

2 AOPDs Type 4 with 2 safety-related transistor outputs and internal cross connection monitoring function each.

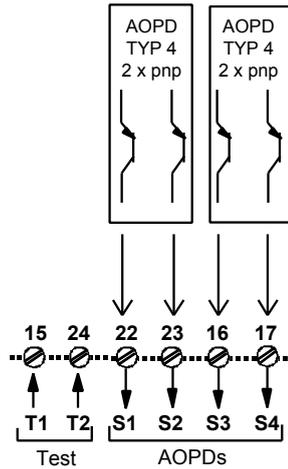


Example 2

1 AOPD Type 4 with 2 safety-related transistor outputs and internal cross connection monitoring function.

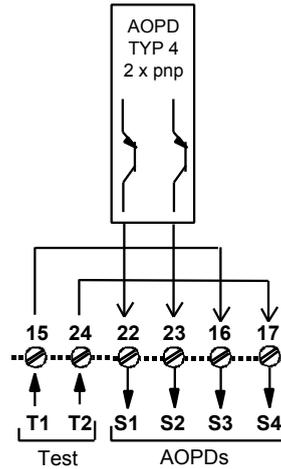


Example 3

2 AOPDs Type 4 with 2 normally open contacts each. Separated connection cables to the individual AOPDs are required.

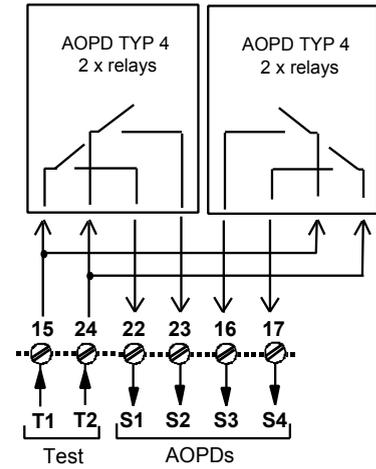


Example 4

1 AOPD Type 4 with 2 normally open contacts and 1 safety switch. Separated connection cables to the individual safety components are required.

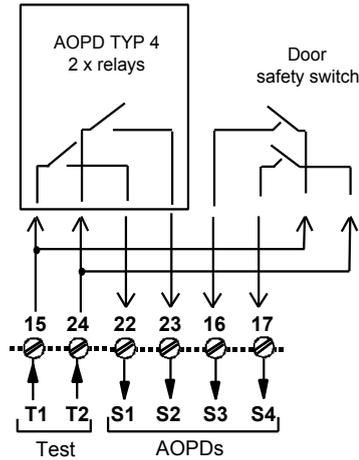


Example 5

3 AOPDs Type 2 with 1 safety-related transistor output each. Separated connection cables to the individual AOPDs are required.

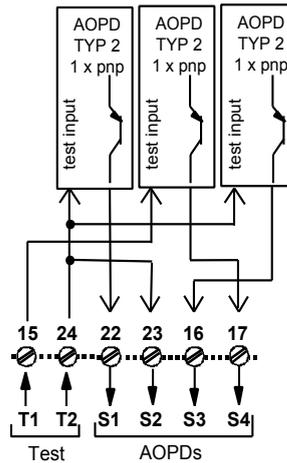

Example 6

4 AOPDs Type 2 with 1 safety-related transistor output each. Separated connection cables to the individual AOPDs are required.

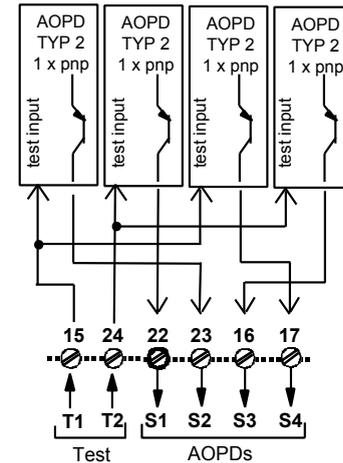

4.4 Connecting Machine Controls



The safety-related parts of the controls comprise more than the MSI-sx/Rx described above. They also include successive control elements and even power transmission elements which must be safely and promptly shut down. Particular attention must be paid to maintaining the safety category requirements. Important information in this regard can be found in the harmonized European standard DIN EN ISO 13849-1.



Essential prerequisites for safe operation are the abilities to electrically influence the interruption of the dangerous movement and to bring the machine to a standstill as


quickly as possible. These factors, as well as the response times of AOPDs and the MSI, must be taken into consideration when calculating the safety distance.

The response times depend on the type of AOPD selected (see Chapter 6, Technical Data). Other parameters, such as hand/arm/body approach speed or additional safety distance, depend on the particular application and the resolution of the AOPD being used. The European standard DIN EN ISO 13855 contains equations and examples for a variety of configurations.


5 Connection Circuit Diagram, Examples

The connection examples below show a wiring suggestion for the MSI-sx/Rx as well as a connection example

for an EMERGENCY STOP button.

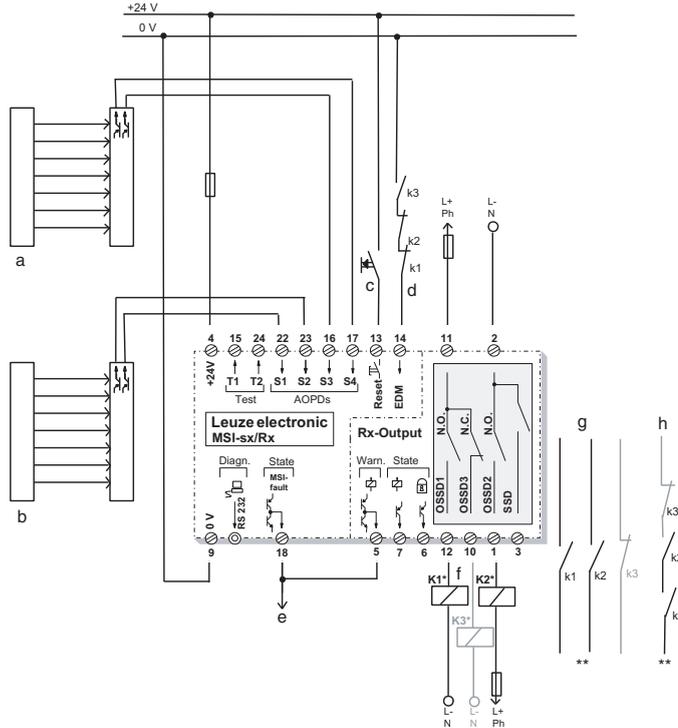

Connection example MSI-sx/Rx with two AOPD Type 4

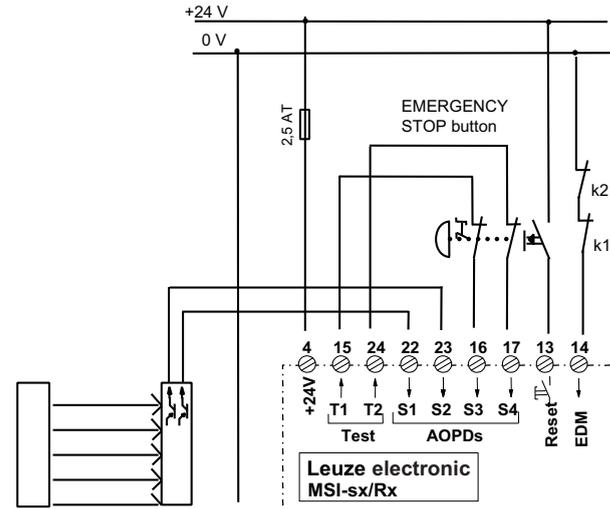

Example: connection of two-channel EMERGENCY STOP button

- a = AOPD Type 4
- b = AOPD Type 4
- c = Command device for releasing the start/restart interlock
- d = Feedback loop for external device monitoring
- e = Possible collective output for warning/error indications
- Pin 18 = Indicating output "MSI-Fault"
- Pin 5 = Warning output "prediction of relay failure"
- Pin 7 = Indicating output "status safety outputs"
- Pin 6 = Indicating output "status start/restart interlock"
- f = Output Signal Switching Devices (OSSDs)
- Pin 3 = Secondary Switching Device (SSD) opens in case of failures
- g = Switching off path with two-(three)-channel control
- h = Switching off path with one-channel control
- * = Suitable spark suppression required
- ** = In general, both of the contacts must be used in the subsequent machine control path. Use relays or contactors with positive-driven contacts only.

All available safety inputs must be occupied!

See Chapter 4.3.

6 Technical Data and Ordering Information

6.1 MSI-sx/Rx

Version, Type Modular Safety Interface	MSI-sx	
Type in accordance with DIN EN IEC 61496-1	Type 4	
SIL in accordance with IEC 61508	SIL 3	
Performance Level (PL) in accordance with DIN EN ISO 13849-1	PL e	
Category in accordance with DIN EN ISO 13849-1	Cat. 4	
Mean probability of a dangerous failure per hour (PFH _d) as a function of the mean number of annual switching cycles of the relay n _{op} *	100% Last n _{op} = 4.800: 1,6 x 10 ⁻⁰⁸ 1/h 60% Last n _{op} = 4.800: 1,3 x 10 ⁻⁰⁸ 1/h 100% Last n _{op} = 28.800: 3,8 x 10 ⁻⁰⁸ 1/h 60% Last n _{op} = 28.800: 1,6 x 10 ⁻⁰⁸ 1/h 100% Last n _{op} = 86.400: 9,5 x 10 ⁻⁰⁸ 1/h 60% Last n _{op} = 86.400: 2,4 x 10 ⁻⁰⁸ 1/h	
Number of cycles until 10 % of the components have a failure to danger (B _{10d})	400,000: 100% of the max. switched current of loading cases AC1..DC13 2,500,000: 60% of the max. switched current of loading cases AC1..DC13 20,000,000: 60% of the max. switched current of loading cases AC1..DC13	
Service life (T _M)	20 years	
Connectable safety sensors S1-S4	up to 2 AOPDs, Type 4, Type 3 or up to 4 AOPDs Type 2 (all in accordance with DIN EN IEC 61496-1)	
Connectable safety switches and command units at S1-S4	Safety switches according to EN 1088 Area Emergency-Stop button according to EN ISO 13850	
Test outputs T1 and T2, Test interval Test impulses, time-displaced Response time AOPD Type 2 to a test request	200 ms 24 ms each 2 to 18 ms	
Available functions	Start/restart interlock External device monitoring	
Control input Start/restart interlock (Reset)	Potential-free normal open contact (button or key button)	


Control input External device monitoring (EDM)	Feedback of positive-guided contacts from downstream relays (see connection diagram in Chapter 5)
Indication output MSI-Fault	push-pull transistor output no fault message active high, 24 V DC 60 mA max. fault message active low
Safety outputs (Technical Data, see below)	Relay outputs via /Rx-Output
Supply voltage	24 V DC, ± 20%, external power supply (PELV) with safe mains separation and equalization for 20 ms voltage interruption required
Current consumption	approx. 200 mA without external load
External fusing	2.5 A m
Housing Enclosure rating	IP 20; must be installed in electronics cabinet or housing with an enclosure rating of at least IP 54 Mounting at 35 mm DIN standard rail
Protective class	II
Ambient temperature, Operation	0 ... + 55 °C
Ambient temperature, Storage	-25 ... + 70 °C
Relative humidity	93 % max.
Connection type (GS-ET-20: 2014)	pluggable, coded screw-type terminals Cable cross-section min., rigid, flexible: 0.14 mm ² Cable cross-section max., rigid, flexible: 2.5 mm ² Cable cross-section AWG/kcmil, min./max.: 26/14 Cable cross-section UL AWG/kcmil: 30-12
Dimensions	See dimensional drawing
<p>*n_{op} = mean number of annual actuations, see C.4.2 and C.4.3 of DIN EN ISO 13849-1</p> <p>Use the following formula to calculate the mean number of annual actuations:</p> $n_{op} = (d_{op} \cdot h_{op} \cdot 3600 \text{ s/h}) \div t_{Zyklus}$ <p>In doing so, make the following assumptions with regard to the use of the component: h_{op} = mean operating time in hours per day d_{op} = mean operating time in days per year t_{Zyklus} = mean time between the start of two successive cycles of the component (e.g switching of a valve) in seconds per cycle</p>	

6.2 /Rx-Output

OSSD safety outputs switching voltage/switching current	2 safety-related normal open contacts, 60 V DC, 250 V AC, 5 A max. 1 safety-related normal closed contact, 60 V DC, 250 V AC, 5 A max. Minimum switching current 20 m A			
OSSD external fusing (EN 60269-1)	4A gG D-fuse			
Contact currents (IEC EN 60947-5-1)	AC15, 3A DC13, 2A			
OSSD response time MSI (without AOPD)	for AOPD Type 4, transistor outputs	22 ms		
	for AOPD Type 4, relay outputs	64 ms		
	for AOPD Type 2	64 ms		
	for safety switches	64 ms		
OSSD reset time	100 ms			
OSSD suitable spark extinguishing over the coils of the downstream relays	Required			
SSD secondary switching device (closes after successful start-up test, opens in case of fault) switching voltage/switching current	1 normal open contact, 60 V DC, 250 V AC, 5 A max. Minimum switching current 20 mA			
SSD external fusing  SSD (Secondary Switching Device) not to be used for safety circuit!	5 A m			
 Status output "Status switch outputs" not to be used for safety circuit!	pnp switch output			
	OSSDs ON-state:	active high,	24 V DC,	60 mA max.
	OSSDs OFF-state:	active low		
Status output "Status start/restart interlock"	pnp switch output			
	locked:	active high,	24 V DC,	60 mA max.
	not locked:	active low		
OSSD currents over the contacts at 230 V AC switching voltage	≤ 0.75 A	> 0.75 A	> 1.5 A	> 3 A
		≤ 1.5 A	≤ 3 A	≤ 5 A

Recommended limit of operations by way of DIP switch of Rx Module (factory setting 1,000,000)	1,000,000	500,000	200,000	100,000
Status output "Warning – preset no. of operations reached"	Push-pull transistor output Operations not reached: Operations reached:		active high, 24 V DC 60 mA max. active low	

6.3 Dimensional Drawing

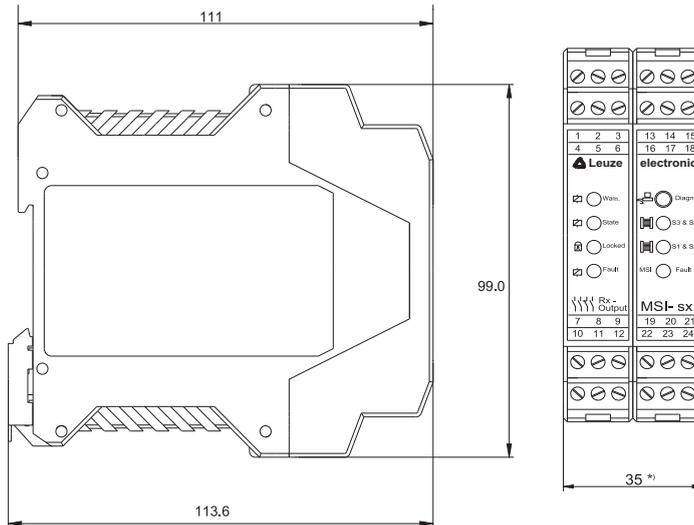

*) Stringing together without distance possible

6.4 Ordering Information

Type	Part No.
MSI-sx/Rx	549901
MSI diagnosis software	549930
PC cable 3 m	549953
PC cable 5 m	549955
/Rx output subassembly (replacement part)	509211



the **sensor** people

**EG-KONFORMITÄTS-
ERKLÄRUNG
(ORIGINAL)**

Der Hersteller

The Manufacturer

Leuze electronic GmbH + Co. KG
In der Braike 1, PO Box 1111
73277 Owen, Germany

Le constructeur

**EC DECLARATION OF
CONFORMITY
(ORIGINAL)**

**DECLARATION CE DE
CONFORMITE
(ORIGINAL)**

erklärt, dass die nachfolgend
aufgeführten Produkte den
entsprechenden Anforderungen der
genannten EG-Richtlinien und
Normen entsprechen.

déclare que les produits identifiés
suivants sont conformes aux
directives CE et normes
mentionnées.

Produktbeschreibung:

Description of product:

Description de produit:

Sicherheits-Interface zur
Auswertung sicherheitsrelevanter
Signale und Erzeugung
sicherheitsgerichteter
Abschaltsignale auf Basis einer
zweikanaligen
Mikroprozessorseuerung
Sicherheitsbauteil nach 2006/42/EG
Anhang IV
MSI (Modulares Sicherheits-Interface)
(-s, -sx), (-i, -ix), (-m, -mx), (-mE, -mxE)
Seriennummer siehe Typschild

Safety interface device to evaluate
safety related signals and to
create safety related output
switching signals based on two
micro-processors
safety component in acc. with
2006/42/EC annex IV
MSI (Modular Safety Interface)
(-s, -sx), (-i, -ix), (-m, -mx), (-mE, -mxE)
Serial no. see name plates

Interface de sécurité pour
l'exploitation de signaux relatifs à
la sécurité et la génération de
signaux de coupure sécuritaires
sur la base d'une commande à
microprocesseur à deux canaux
Élément de sécurité selon
2006/42/CE annexe IV
MSI (Module interface de sécurité)
(-s, -sx), (-i, -ix), (-m, -mx), (-mE, -mxE)
N° série voir plaques
signalétiques

Angewandte EG-Richtlinie(n):

Applied EC Directive(s):

Directive(s) CE appliquées:

2006/42/EG
2004/108/EG

2006/42/EC
2004/108/EC

2006/42/CE
2004/108/CE

Angewandte Normen:

Applied standards:

Normes appliquées:

DIN EN 62061:2013, DIN EN ISO 13849-1:2008; DIN EN ISO 13849-2:2013; GS-ET-20 :10/2014
EN 60204:2007; EN 61496-1:2013

Benannte Stelle /

Notified Body /

Organisme notifié /

Baumusterprüfbescheinigung:

Certificate of Type Examination:

Attestation d'examen CE de type:

Institut für Arbeitsschutz der Deutschen Gesetzlichen

Unfallversicherung IFA

Alte Heerstr. 111

D-53757 St. Augustin

Europäisch notifizierte Stelle Nr. 0121

1001187

Dokumentationsbevollmächtigter

Authorized for documentation is

Autorisé pour documentation est

ist der genannte Hersteller,

the stated manufacturer, contact:

le constructeur déclaré, contact:

Kontakt: quality@leuze.de

quality@leuze.de

quality@leuze.de

Leuze electronic GmbH + Co. KG,
In der Braike 1 D-73277 Owen,
quality@leuze.de

Owen, 24.04.2015

Ulrich Berbach, Geschäftsführer / Director / Directeur

Datum / Date / Date

Ulrich Berbach, Geschäftsführer / Director / Directeur

Ulrich Berbach, Geschäftsführer / Director / Directeur

Leuze electronic GmbH + Co. KG, Sitz Owen | Regalagerstr. Stuttgart, IRB 2.20550

Leuze electronic GmbH + Co. KG, Sitz Owen | Regalagerstr. Stuttgart, IRB 2.20550

Leuze electronic GmbH + Co. KG, Sitz Owen | Regalagerstr. Stuttgart, IRB 2.20550

Präzisionstechnik

Präzisionstechnik

Präzisionstechnik

Geschäftsbereich 2015

Geschäftsbereich 2015

Geschäftsbereich 2015

Es gelten ausschließlich unsere aktuellen Verkaufs- und Lieferbedingungen.

Es gelten ausschließlich unsere aktuellen Verkaufs- und Lieferbedingungen.

Es gelten ausschließlich unsere aktuellen Verkaufs- und Lieferbedingungen.

